

# PRODUCT SPECIFICATIONS

# TubeTrace® Type SE/ME ELECTRICALLY HEATED INSTRUMENT TUBING


with **VSX™-HT** Self-Regulating Heat Tracing

#### **APPLICATION**

TubeTrace, with "cut-to-length" VSX-HT self-regulating heat tracing, is designed to provide freeze protection or temperature maintenance from 5°C (40°F) to 149°C (300°F) for tubing where high temperature exposure capability is possible. VSX-HT withstands intermittent temperature exposures of 232°C (450°F).

Self-regulating VSX-HT heat tracing:

- Varies in response to the surrounding conditions along the entire length of a circuit.
- Lower risk of overheating the tube or product.
- Installed cost is lower because "cut-to-length" VSX-HT makes end connections easy with minimal waste.
- VSX-HT is approved for use in ordinary (non-classified) areas and hazardous (classified) areas.

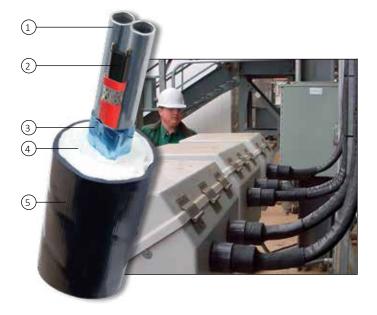

#### **RATINGS**

VSX-HT	Ratings
Available watt densities	16, 33, 49, 66 w/m @ 10°C 5, 10, 15, 20 w/ft @ 50°F
Supply voltages	110-120 or 208-277 Vac
Tube temperature range	5°C to 149°C (40°F to 300°F)
Max. exposure temperature <sup>1</sup> Intermittent power-on or off	250°C (482°F)
T-rating 16, 33 w/m (5, 10 w/ft.) 49, 66 w/m (14, 20 w/ft.) Based on stabilized design <sup>2</sup>	T3 200°C (392°F) T2C 230°C (446°F) T2 to T6

# **CONSTRUCTION**

- 1 Process tube(s)
- 2 VSX-HT self-regulating electrical heat tracing
- 3 Heat reflective tape
- 4 Non-hygroscopic glass fiber insulation
- 5 Polymer outer jacket (ATP or TPU available)

## **PRODUCT FEATURES**

- Self-regulating
- "Cut-to-length"
- Hazardous area approvals


For additional information on VSX-HT and other Thermon heat tracing products and services, visit www.thermon.com.

#### Note

- 1. This reflects maximum exposure for heater. If bundle jacket is to remain below 60°C (140°F) in 27°C (+80°F) ambient (in consideration of personnel burn risk) tube temperature must remain below 205°C (400°F). Alternative designs to keep jacket below 60°C (140°F) in higher ambients and/or with higher tube temperatures are available. Contact Thermon.
- 2. Thermon heating cables are approved for the listed T-ratings using the stabilized design method. This enables the cable to operate in hazardous areas without limiting thermostats. The T-rating may be determined using CompuTrace® Electric Heat Tracing Design Software or contact Thermon for design assistance.

## **POWER OUTPUT CURVES**

The power outputs shown apply to cable installed on insulated metallic pipe (using the procedures outlined in IEEE Standard 515) at the service voltages stated below. For use on other service voltages, contact Thermon.

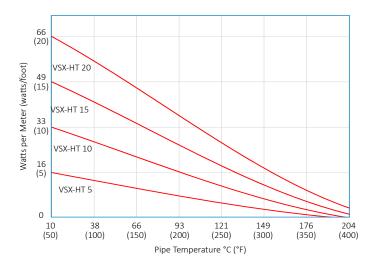

## **DESIGN TOOLS**

Technical Design Information and CompuTrace® - IT computer design program for TubeTrace heated instrument tubing are available online at www.thermon.com.


## **TUBETRACE ACCESSORIES**

Sealing the ends of pre-insulated tubing bundles ensures their efficient and reliable performance. A variety of termination kits and accessories are available and can be found on Form CLX0020.

## **ELECTRICAL HEAT TRACE ACCESSORIES**

Thermon manufactures every type of electrical resistance heat tracing available in the world today. Power connection and termination kits (Form CLX0024) and a variety of controls are all available for heated instrument tubing applications.

#### **HOW TO SPECIFY**

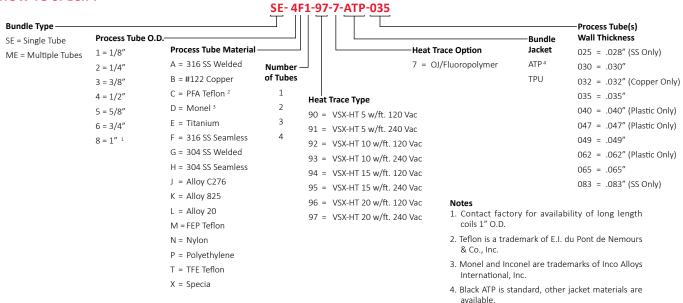

# **CERTIFICATIONS/APPROVALS**



FM Approvals
Ordinary Locations
Hazardous (Classified) Locations
Class I, Division 2, Groups B, C and D
Class II, Division 2, Groups F and G
Class III, Divisions 1 and 2
Class I, Zones 1 and 2, AEx eb IIC, AEx tb IIIC



Canadian Standards Association
Ordinary Locations
Hazardous (Classified) Locations
Class I, Division 1, Groups A, B, C and D
Class II, Division 1, Groups E, F and G
Class I, Division 2, Groups A, B, C and D
Class II, Division 2, Groups E, F and G
Ex eb IIC, Ex tb IIIC